



SOUND ABSORPTION TEST REPORT

EN ISO 354:2003

For

Remak™ Sonic

Model: 1220*2420*9mm

Brand Name: REMAK

Report No.: ENC140217GZ58E1

Date of Issue: Feb. 21, 2014

Prepared For

Remak Construction and Interior JSC

Lot 14B, The Auction, Le Duc Tho street, Tu Liem, Ha Noi, Vietnam

TEL: 0084.4.22427731

FAX: 0084.4.62872438

Prepared By

East Notice Certification Service Co., Ltd.

**1/F, Haohui Commercial Building, Zhuji Street, Dongpu Town, Tianhe District,
Guangzhou City, China**

TEL: 86-020-2331 4234

FAX: 86-020-8256 8534

The results shown in this test report refer only to the sample(s) tested unless otherwise stated and the sample(s) are retained for 30 days only. The document is issued by ENC, this document cannot be reproduced except in full with our prior written permission. The document is available on request and the brief information for its validation can be assessable and confirmed at <http://www.enc-lab.com>.



1/F, Haohui Commercial Building, Zhuji Street,
Dongpu Town, Tianhe District, Guangzhou City

Tel: +86-020-2331 4234
E-mail: enc@enc-lab.com

Fax: +86-020-8256 8534
[Http:// www.enc-lab.com](http://www.enc-lab.com)

GENERAL INFORMATION:

Product Description:	Remak™ Sonic
Model Number:	1220*2420*9mm
Model Difference:	N/A
Brand Name:	REMAK
Applicant:	Remak Construction and Interior JSC Lot 14B, The Auction, Le Duc Tho street, Tu Liem, Ha Noi, Vietnam
Manufacturer:	Remak Construction and Interior JSC Lot 14B, The Auction, Le Duc Tho street, Tu Liem, Ha Noi, Vietnam
Report No.:	ENC140217GZ58E1
Test Methods:	EN ISO 354:2003 Acoustics - Measurement of sound absorption in a reverberation room. The absorption class was determined in conformance with EN ISO 11654:1997
Test Results:	See next sheet
Sample Receiving Date:	Feb. 17, 2014
Test Performing Date:	Feb. 17, 2014 – Feb. 21, 2014

Summary of test results

Octave centre frequency f / Hz	125	250	500	1000	2000	4000	α_w	Sound absorption class
Remak™ Sonic (1220*2420*9mm)	0.35	0.70	0.95	0.90	0.95	0.90	0.85	B

Checked By



Yemig Feb. 21, 2014

Authorized By



Ray Zhou Feb. 21, 2014

The results shown in this test report refer only to the sample(s) tested unless otherwise stated and the sample(s) are retained for 30 days only. The document is issued by ENC, this document cannot be reproduced except in full with our prior written permission. The document is available on request and the brief information for its validation can be assessable and confirmed at <http://www.enc-lab.com>.




Annex1: Test result

Specimen: Remak™ Sonic
Client: Remak Construction and Interior JSC
Laboratory: East Notice Certification Service Co., Ltd.

Model: 1220*2420*9mm **Test room volume:** 155 m³
Temperature of test room: 23 °C **Area of room boundaries:** 179 m²
Relative humidity: 58 % **Test date:** 2014-02-18
Atmospheric pressure: 101 KPa **Test file identification:** ENC140217GZ58E1-1

Third octave band results:

Frequency [Hz]	α_s 1/3 octave	α_p oktave
100	0.28	0.35
125	0.30	
160	0.47	
200	0.65	0.70
250	0.67	
315	0.76	
400	0.95	0.95
500	0.91	
630	0.94	
800	0.92	0.90
1000	0.89	
1250	0.91	
1600	0.93	0.95
2000	0.95	
2500	0.92	
3150	0.89	0.90
4000	0.84	
5000	0.92	

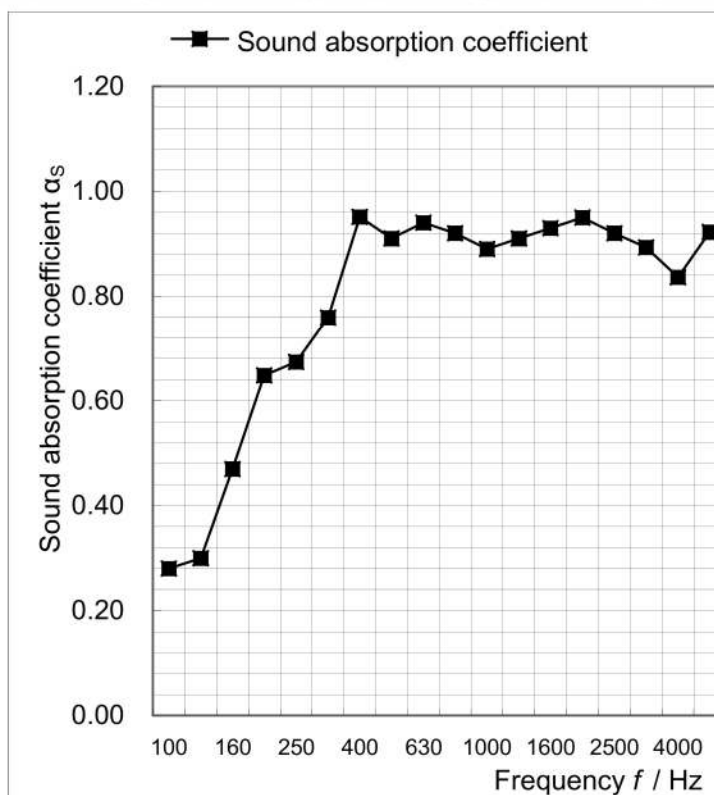

α_s Sound absorption coefficient according to EN ISO 354



α_p Practical sound absorption coefficient according to EN ISO 11654

Weighted sound absorption coefficient $\alpha_w = 0.85$, Sound absorption class: B

The results shown in this test report refer only to the sample(s) tested unless otherwise stated and the sample(s) are retained for 30 days only. The document is issued by ENC, this document cannot be reproduced except in full with our prior written permission. The document is available on request and the brief information for its validation can be assessable and confirmed at <http://www.enc-lab.com>.

Annex 2: Mounting of specimen

The specimen was mounted in the reverberation room in conformance with EN ISO 354:2003 Annex B.

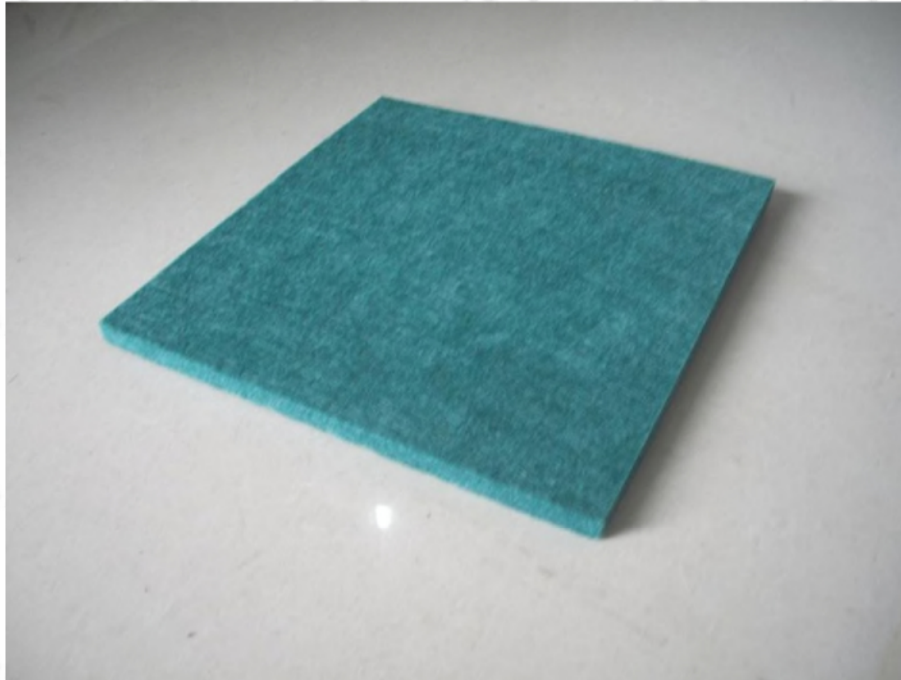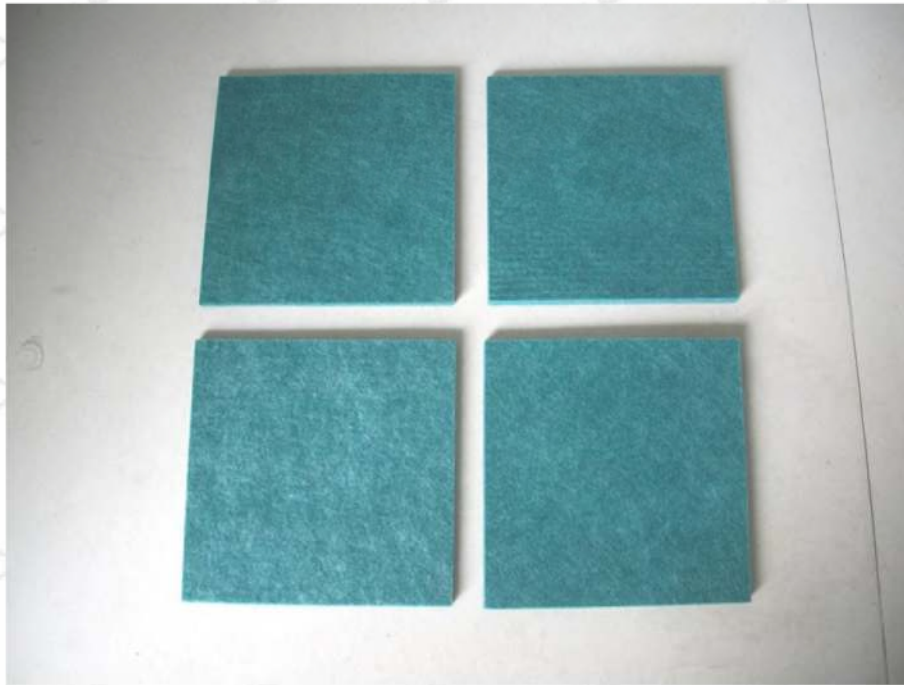

The results shown in this test report refer only to the sample(s) tested unless otherwise stated and the sample(s) are retained for 30 days only. The document is issued by ENC, this document cannot be reproduced except in full with our prior written permission. The document is available on request and the brief information for its validation can be assessable and confirmed at <http://www.enc-lab.com>.

Annex 3: Measurement arrangements

1. Acoustical measurements

The test signal was produced to the test room using three fixed omnidirectional loudspeakers (6 x Seas B&K2260D). The test signal (pink noise) was produced by a real time analyzer (Bruel & Kjaer 2133) and amplified with terminal amplifier (B&K2716). The sound pressure level in the reverberation room was measured with a condenser microphone on a tripod (B&K 5821 equipped with a pre-amplifier B&K4296).

The reverberation time at third-octave bands was measured with the real time analyzer (B&K4189) using 20 dB decay range. All frequency bands were measured using 2 sources simultaneously and 4 microphone locations. In every location an ensemble average of 10 decays was measured. The total number of reverberation time measurements was 8.

The acoustical measurement equipment fulfilled the following IEC standards and grades of accuracy:

IEC 651	Sound level meters	type 1
IEC 804	Integrating sound level meters	type 1
IEC 1260	Octave-band and fractional-octave-band filters	class 1
IEC 942	Sound level calibrators	class 1

2. Other measurements

The temperature and the relative humidity of the measurement rooms were measured with a psykrometer (Casella London 7165). The ambient atmospheric pressure was measured with a barometer (B&K MD0001). The specimen was weighed with a 150 kg precision weighing machine (PM 150). The dimensions of the specimen were measured with a roll meter (K-Prof).

3. The test room

The reverberation room was equipped with six fixed diffuser panels. The positions were selected randomly in respect with altitude, angle and position. The amount of diffusers and their arrangement fulfills the requirements of Annex A in ISO 354. The reverberation time of the reverberation room fulfills the requirements of EN ISO 354 for 155 m³ test room.

4. References to the ISO standards

Test: EN ISO 354:2003 (E) Acoustics - Measurement of sound absorption in a reverberation room, International Organization for Standardization, 2003, Genève, Switzerland.

SFS-EN ISO 11654 Acoustics - Sound absorbers for use in buildings - Rating of sound absorption, International Organization for Standardization, 1997, Genève, Switzerland

---- END OF REPORT ----

The results shown in this test report refer only to the sample(s) tested unless otherwise stated and the sample(s) are retained for 30 days only. The document is issued by ENC, this document cannot be reproduced except in full with our prior written permission. The document is available on request and the brief information for its validation can be assessable and confirmed at <http://www.enc-lab.com>.

